

This Legal Acknowledgement Form shall be governed by the laws of the Province of British Columbia and the applicable federal laws of Canada. In the event of conflicts or inconsistencies, if any, between or among this Legal Acknowledgement Form and the terms and conditions of the Standard, the provisions set out in this Legal Acknowledgement Form take precedence.

Disclaimer

The Standard, and all information and referenced standards therein, is provided as a public service by the British Columbia Hydro and Power Authority ("BC Hydro"). Material contained within it carries no guarantee of any kind, express or implied.

Neither BC Hydro nor the Standard designer, recommender, or acceptor, are accountable for the manner in which the Standard is used, or in the way its content is applied. Persons using the Standard, including retained engineers and contractors, are responsible and assume full responsibility and liability for its application, including but not limited to ensuring that the application of its content is appropriate, and that its application does not compromise operability, safety, reliability or maintainability.

The Standards have been prepared for or by BC Hydro to meet specific purposes of BC Hydro. No person shall use or rely upon the Standard, in whole or in part, in any manner, except:

- a) for the purpose of providing services to BC Hydro;
- b) for the purpose of connecting equipment to BC Hydro equipment;
- c) with the prior written consent of BC Hydro, or
- d) as required by law.

Limitation of Liability

BC Hydro, its servants or agents, shall not be liable to any person for injury, loss or damage arising out of the use of or reliance upon this Standard, in whole or in part, except for those situations where the person uses the Standards to provide services to BC Hydro to the extent damages are not due to the fault of the person using the Standard, including but not limited to that person's misapplication of the Standard, negligence, or misconduct.

Any person using these Standards hereby agrees to release and indemnify BC Hydro, its servants or agents, from any injury, loss, damage or claim arising or alleged to be arising from use of or reliance upon the Standards, in whole or in part, except for those situations where the person directly uses the Standards to provide services to BC Hydro to the extent damages are not due to the fault of the person using the Standard, including but not limited to that person's misapplication of the Standard, negligence, or misconduct.

Copyright

BC Hydro holds all title and rights, including the copyright, in or to the Standard. Copying all or any part of this Standard is permitted provided copies are used in accordance with this Legal Acknowledgement Form, credit is given to BC Hydro, and copies of the Standard or parts thereof are not sold for profit. The Standard may be stored in any type of electronic retrieval system provided BC Hydro is clearly indicated as the source and provided no profit accrues from such storage.

BC Hydro notes that the Standard may be revised from time to time and recommends that any person using the Standard in accordance with this Legal Acknowledgement Form confirm it is using the most recent version. BC Hydro is not liable for reliance on past versions of the Standard that may be stored electronically.

REVISIONS: UPDATED LEGAL ACKNOWLEDGEMENT FORM. FD MAR '16

DESIGNED J. AGNOLIN	RECOMMENDED  F. DENNERT	ACCEPTED  G. REIMER	ENGINEER OF RECORD 	NOTICE FROM THE EXECUTIVE VICE PRESIDENT TRANSMISSION AND DISTRIBUTION AND CUSTOMER SERVICE	
DISTRIBUTION STANDARDS 		ISSUED: MAR 2016 REPLACES: MAY 2004 ORIGINALLY ISSUED: NOV 1980		PAGE 1 OF 2	ES43/53/54/55/65 A1-01.01 ^R 4

Scope

This manual is one of a series containing standards for construction of the BC Hydro electrical distribution plant within the service area of BC Hydro. A new distribution plant shall be designed, constructed, owned, operated, maintained and repaired to these standards.

Purpose of Standards

BC Hydro objectives require standardization to:

- a) Ensure uniform safety requirements comply with BC statutes and regulations.
- b) Provide uniform system reliability.
- c) Provide uniform operating practices.
- d) Permit economic bulk purchasing of materials.
- e) Achieve optimum life cycle cost of plant construction.
- f) Effect efficient quality assurance.

Responsibility

The Distribution Standards Department prepares these standards and verifies that specified plant and procedures will perform adequately under all normally expected conditions encountered throughout the province of British Columbia. These standards are approved by Professional Engineers. It is the responsibility of BC Hydro Managers to ensure that the standards are followed unless abnormal conditions are encountered that require variations. These variations should be kept to a minimum and their performance shall be the responsibility of the Professional of Record in charge of the project, who will record and seal the variation based on satisfactory qualifications and experience to do so. As per the latest revision of the BC Hydro Distribution Owner's Engineer Guide, these variations must be accepted by BC Hydro's Owner's Engineer.

Use of Stock Materials

The electrical distribution plant covered by these standards is built using stock materials approved by a Professional Engineer as required by law. The use of non-stock materials for special and unusual situations must be approved by Distribution Standards or the BC Hydro Engineer responsible for the project.

Revisions to Manual

These standards are revised from time to time to improve the safety, performance, workability, cost effectiveness or appearance of the plant. The existing plant built to previous standards need not be updated unless so specifically advised by BC Hydro. When maintenance or other work, such as voltage conversion or conductor change is being done, updating plant to current standards is encouraged.

Mailing Addresses

The manual has been issued to a corporation or firm rather than to an individual. The corporation or firm is responsible for the safekeeping of the manual, and for keeping it current. Changes of address or in number of copies required must be reported promptly.

Suggestions for changes in the manual, or required changes of address may be made on the pre-addressed comment sheet included in the Manual and with each issue of revision.

REVISIONS: UPDATED LEGAL ACKNOWLEDGEMENT FORM. FD MAR '16

DESIGNED J. AGNOLIN	RECOMMENDED  F. DENNERT	ACCEPTED  S. REIMER	ENGINEER OF RECORD  F. U. DENNERT PROFESSIONAL ENGINEER BRITISH COLUMBIA	NOTICE FROM THE EXECUTIVE VICE PRESIDENT TRANSMISSION AND DISTRIBUTION AND CUSTOMER SERVICE		
DISTRIBUTION STANDARDS BC Hydro		ISSUED: MAR 2016 REPLACES: MAY 2004 ORIGINALLY ISSUED: NOV 1980		PAGE 2 OF 2	ES43/53/54/55/65 A1-01.02	R 4

Requirements for Complex Revenue Metering

To view the latest version of this document go to:
<http://www.bchydro.com/ext/metering/>

March 2016



Copyright and Reprint Provision

Copyright © 2014 by BC Hydro.

Reprint Provisions:

- (a) Copying all or any part of this document is permitted provided credit is given to BC Hydro and provided the copies of this document or parts thereof are not sold for profit; and
- (b) This document may be stored in any type of electronic retrieval system provided BC Hydro is clearly indicated as the source and provided no profit accrues from such storage.

Table of Contents

1. Overview	1
2. Disclaimer	2
3. General	3
3.1 Approval.....	3
3.2 Location	3
3.3 Access	3
3.4 Illumination.....	3
4. Point-of-Metering.....	4
4.1 BC Hydro Side of the Power Transformer	4
4.2 Customer/Power Generator Side of the Power Transformer	4
4.3 Loss Compensation	4
4.3.1 Power Transformer Loss Compensation	4
4.3.2 Line Loss Compensation.....	5
4.4 Station Service	5
5. Voltage Transformers and Current Transformers	6
5.1 General Requirements	6
5.1.1 BC Hydro Side of the Power Transformer	6
5.1.2 Customer/Power Generator Side of the Power Transformer	7
5.1.3 Primary Winding.....	7
5.1.4 VT and CT Specification.....	8
5.1.5 Lightning Arrestors	8
5.2 Individual Outdoor VTs and CTs	9
5.2.1 Meter Cabinet at the Support Structure	9
5.2.2 Meter Cabinet not at the Support Structure	9
5.3 Outdoor Metering Kits	9
5.3.1 Meter Cabinet at the Base of the Pole.....	9
5.3.2 Meter Cabinet not at the Base of the Pole	9
5.3.3 Typical Installation Drawing.....	10
5.4 Individual Indoor VTs and CTs	10
5.4.1 Instrument Transformer Compartment	10
5.4.2 Instrument Transformer Compartment Doors	10
5.4.3 Interlocks	11
5.4.4 Neutral Bus	12
5.4.5 Ground Bus.....	12
5.4.6 Working Ground Points	12
5.4.7 VTs and CTs	13
6. Meter Cabinet.....	16
6.1 Location	16
6.2 Installation.....	16
6.3 Grounding	16
6.4 Auxiliary Power	16
7. VT and CT Secondary Winding Wiring	17
7.1 General	17
7.2 Access to the Second set of Secondary Windings.....	17
7.3 Cables.....	18
7.3.1 Typical Configurations.....	18
7.3.2 Armoured Cable Requirements	18
7.3.3 Individual Conductors in Conduit Requirements	19

8. Telecommunications	20
8.1 Transmission System Connected Facilities with Wire-Line Telephone	20
8.2 Distribution System Connected Facilities with Wire-Line Telephone	21
9. Measurement Canada	22
10. Responsibilities and Charges	23
10.1 Responsibilities	23
10.2 Charges	26
10.2.1 Customer Charges for Load Only Applications	26
10.2.2 Power Generator Charges for Generation Applications	26
10.3 Typical Additional Charges for Load Only Customers:	26
10.3.1 Additional Points of Metering	26
10.3.2 Customer on site Access to real time Revenue Meter Data	27
11. Drawings	28

1. Overview

This document contains the requirements for complex revenue metering, applicable to:

- Transmission Voltage Connected Load Customers
- Transmission and Distribution Voltage Inter-ties with other utilities
- Transmission and Distribution Voltage Connected Power Generators
- Other applications such as multiple connections and other metering applications at BC Hydro's discretion

Normally a main meter and a backup meter will be installed to record the power delivered by BC Hydro to the Customer or the Power Generator and, if there is generation, the power received by BC Hydro from the Power Generator.

Responsibilities are dependent upon whether the installation is:

- **Load Only** - where the **Customer** only purchases power from BC Hydro; or
- **Generation** - where the **Power Generator** typically sells power to BC Hydro but may occasionally purchase power from BC Hydro.

BC Hydro Power System	BC Hydro Voltage Class	Nominal Voltage	CSA Equipment Voltage Class
Transmission System	500 kV	500,000 V	550 kV
	360 kV	345,000 V	362 kV
	287 kV	287,000V	300 kV
	230 kV	230,000 V 3 Phase, 3 Wire	245 kV
	138 kV	138,000 V 3 Phase, 3 Wire	145 kV
	69 kV	69,000 V 3 Phase, 3 Wire	72.5 kV
Distribution System	35 kV *	19,920/34,500Y V 3 Phase, 4 Wire	35 kV
	25 kV	14,400/24,940Y V 3 Phase, 4 Wire	27.5 kV
	12 kV	7,200/12,470Y V 3 Phase, 4 Wire	15 kV
	4 kV	2,400/4,160Y V 3 Phase, 4 Wire	5 kV

* Restricted to a limited number of rural circuits in the Central Interior.

Changes to this revision are indicated by vertical lines in the left margin.

Comments are written in italics.

2. Disclaimer

This document is not intended as a design specification or as an instruction manual for the Customer/Power Generator and this document shall not be used by the Customer/Power Generator for those purposes. Persons using information included in this document do so at no risk to BC Hydro, and they rely solely upon themselves to ensure that their use of all or any part of this document is appropriate in the particular circumstances.

The Customer/Power Generator, its employees or agents must recognize that they are, at all times, solely responsible for the plant design, construction and operation. Neither BC Hydro nor any of their employees or agents shall be nor become the agents of the Customer/Power Generator in any manner howsoever arising.

BC Hydro's review of the specifications and detailed plans shall not be construed as confirming or endorsing the design or as warranting the safety, durability or reliability of the Customer/Power Generator's facilities. BC Hydro, by reason of such review or lack of review, shall be responsible for neither the strength, adequacy of design or capacity of equipment built pursuant to such specifications, nor shall BC Hydro, or any of their employees or agents, be responsible for any injury to the public or workers resulting from the failure of the Customer/Power Generator facilities.

In general, the advice by BC Hydro, any of its employees or agents, that the Customer/Power Generator's plant design or equipment meets certain limited requirements of BC Hydro does not mean, expressly or by implication, that all or any of the requirements of the law or other good engineering practices have been met by the Customer/Power Generator in its plant, and such judgement shall not be construed by the Customer/Power Generator or others as an endorsement of the design or as a warranty, by BC Hydro, or any of its employees.

The information contained in this document is subject to change and may be revised at any time. BC Hydro should be consulted in case of doubt on the current applicability of any item.

3. General

3.1 Approval

The proposed revenue metering equipment locations shall be approved by BC Hydro.

3.2 Location

Revenue metering equipment:

- (a) Shall be installed in a clean readily accessible location free from severe or continual vibration; and
- (b) Shall be installed in accordance with the latest edition of the Canadian Electrical Code; and
- (c) Shall not be installed in locations which may be hazardous to persons installing, testing or maintaining the equipment; and
- (d) Shall be protected from damage due to vandalism, vehicles etc.

In accordance with Section 2 of the Canadian Electrical Code, a minimum working space of 1 m shall be provided and maintained about the revenue metering equipment.

3.3 Access

BC Hydro shall have reasonable access to the revenue metering equipment to permit its testing and maintenance.

3.4 Illumination

When installed indoors, the meter cabinet shall be installed in a location with a minimum illumination of:

- 100 to 200 lux horizontal at 750 mm (2' 6") above grade; and
- 100 lux vertical at the front face of the meter cabinet.

4. Point-of-Metering

The Point-of-Delivery/Receipt (PODR) is the power custody transfer point and is typically located at, or near, the Point-of-Interconnection (POI) to either the transmission system or the distribution system.

The revenue metering equipment is located at the Point-of-Metering (POM). It is preferable for the POM to be located at the PODR. The PODR is usually located at the POI. Subject to approval by BC Hydro prior to customer's final design, the POM may be located at other locations. If the POM is located in the customer's station, it is typically on the BC Hydro side of the power transformer(s).

When there are multiple power transformers, the POM shall be on the BC Hydro side of the power transformers to avoid multiple POMs.

When there are multiple Customers/Power Generators connecting to a privately owned line, pre-approval of multiple POMs by BC Hydro is required. Additional metering points may apply.

4.1 BC Hydro Side of the Power Transformer

Where the POM is on the BC Hydro side of the power transformer(s), it shall be on the Customer/Power Generator side of the service entrance disconnection device.

4.2 Customer/Power Generator Side of the Power Transformer

Where the POM is on the Customer/Power Generator side of the power transformer, a disconnect device shall not be installed between the power transformer and the POM.

This is to insure that no-load losses are correctly registered whenever the power transformer is energized

4.3 Loss Compensation

If the POM is not located at the PODR, a loss compensation calculation is applied to account for the losses between the POM and the PODR.

4.3.1 Power Transformer Loss Compensation

If the POM is on the Customer/Power Generator side of the power transformer, the manufacturer's transformer test report is required. As well, the following power transformer test data summary, certified by a Professional Engineer, shall be provided by the Customer/Power Generator:

- Rated kVA; and
- Rated primary voltage; and
- Rated secondary voltage; and
- No-load (Iron) losses and
- Load (Copper) losses corrected to 75° C (for 55C° rise) or 85C° (for 65C° rise); and

- % Exciting current; and
- % Impedance

4.3.2 Line Loss Compensation

Where line losses between the POM and the PODR, on either side of the power transformer, are significant, the following line data, certified by a Professional Engineer, shall be provided by the Customer/Power Generator:

- Per phase resistance at ambient temperature; and
- Per phase resistance at the mean anticipated conductor temperature; and
- Per phase inductive reactance; and
- Size, type and code of conductors; and
- Length of line between the POM and the PODR
- GMR (conductor geometric mean radius) in feet
- GMD (conductor geometric mean distance) in feet

4.4 Station Service

The tap for the station service load must be located on the Customer/Power Generator side of the POM.

To allow revenue metering to correctly register both the power received and all the power delivered to the Customer/Power Generator.

5. Voltage Transformers and Current Transformers

5.1 General Requirements

The voltage transformers (VTs) and current transformers (CTs) shall be installed at the POM in accordance with the general requirements of this section and the specific requirements of the appropriate subsequent section.

Since the revenue metering is insensitive to phase rotation direction, the references to Phase A, B and C are totally arbitrary and do not necessarily comply with other designations in the Customer/Power Generators facility. If not explicitly identified, the convention of Phase A, B and C from left-to-right or from top-to-bottom is assumed.

5.1.1 BC Hydro Side of the Power Transformer

Where the POM is on the BC Hydro side of the power transformer, the following VT and CT primary winding connections shall be made:

BC Hydro Power System POI and POM	Metering Elements	VTs (Connected to the phases on the BC Hydro side of the CTs)	CTs (H1 Polarity towards BC Hydro)
69 kV class or higher Transmission System (3 wire)	3	Qty=3, Single Bushing, Connected: - Phase A to Ground (H1 Polarity to Phase A) - Phase B to Ground (H1 Polarity to Phase B) - Phase C to Ground (H1 Polarity to Phase C)	Qty=3 - Phase A - Phase B - Phase C
35 kV class or lower Distribution System (4 wire)	3	Qty=3, Single Bushing, Connected: - Phase A to BC Hydro System Neutral (H1 Polarity to Phase A) - Phase B to BC Hydro System Neutral (H1 Polarity to Phase B) - Phase C to BC Hydro System Neutral (H1 Polarity to Phase C)	Qty=3 - Phase A - Phase B - Phase C

5.1.2 Customer/Power Generator Side of the Power Transformer

Where the POM is on the Customer/Power Generator side of the power transformer, the following VT and CT primary winding connections shall be made:

Customer/Power Generator Power System POM	Metering Elements	VTs (Connected to the phases on the BC Hydro side of the CTs)	CTs (H1 Polarity towards BC Hydro)
3 Wire - Delta; or - Ungrounded Wye; or - Impedance Grounded Wye	2	Qty=2, Two Bushing, Connected: - Phase A to Phase B (H1 Polarity to Phase A) - Phase C to Phase B (For all applications, except switchgear, H1 Polarity to Phase C) (For switchgear applications only, H1 Polarity to Phase B)*	Qty=2 - Phase A - Phase C
4 Wire Solidly Grounded Wye	3	Qty=3, Single Bushing, Connected: - Phase A to Neutral (H1 Polarity to Phase A) - Phase B to Neutral (H1 Polarity to Phase B) - Phase C to Neutral (H1 Polarity to Phase C)	Qty=3 - Phase A - Phase B - Phase C

* See Section 5.4.7.4

5.1.3 Primary Winding

The VT primary windings shall be connected to the phases on the BC Hydro side of the CTs. The CT H1 polarity marks shall be towards BC Hydro. See Section 5.4.7.5.

The VT or CT shall not be used to support the primary winding connections or bus. The primary winding connections shall:

- Not subject the VT and CT bushings to strain; and
- Facilitate the easy replacement of the VT, CT and associated equipment.

5.1.4 VT and CT Specification

As per the Responsibilities section of this document, for Generation applications, the Power Generator is responsible for supplying the VTs and CTs and they shall be in accordance with the requirements of this section.

This section is not applicable to Load Only applications since BC Hydro (not the Customer) is responsible for supplying the VTs and CTs.

5.1.4.1 Measurement Canada Approval

As per the “Electricity and Gas Inspection Act and Regulations”, the VTs and CTs shall be approved by Measurement Canada for revenue purposes and meet Standard CAN/CSA-C60044.

Consult Measurement Canada website for the latest online database for verification of approvals of the chosen VTs and CTs.

5.1.4.2 VT Requirements

The VTs shall have:

- A 0.3% accuracy class or better; and
- A burden adequate for the connected load; and
- A 115 V or 120 V secondary winding.

A 0.3WXY or 0.3WXYZ VT accuracy and burden is typical.

5.1.4.3 CT Requirements

The CTs shall have:

- A 0.3% accuracy class or better; and
- A burden adequate for the connected load; and
- A 5 A secondary winding.

A 0.3B0.9 or 0.3B1.8 CT accuracy and burden is typical.

5.1.4.4 BC Hydro Approval

The Power Generator shall submit the details of the proposed VTs and CTs, and the Measurement Canada approval numbers, to BC Hydro for approval prior to purchase the equipment.

5.1.5 Lightning Arrestors

Where exposed to lightning, the VTs and CTs shall be located within a lightning arrestors zone of protection. For Load-Only Customer's pole mounted metering kit, BC Hydro will supply lightning arrestors. For all the other cases, the Customer/Power Generator shall provide the lightning arrestors.

5.2 Individual Outdoor VTs and CTs

Where individual VTs and CTs are installed on an outdoor support structure, they shall be installed in accordance with the requirements of this section. These individual VTs and CTs could be stand-alone units or combined CT/VT units.

5.2.1 Meter Cabinet at the Support Structure

Where the meter cabinet supplied by BC Hydro is located at the base of the support structure, armoured cables shall connect the individual VTs and CTs directly to the meter cabinet. These armoured cables shall not be installed underground.

5.2.2 Meter Cabinet not at the Support Structure

Where the meter cabinet is not located at the base of the support structure, armoured cables shall connect the individual VTs and CTs directly to a junction box located at the base of the support structure. These armoured cables shall not be installed underground.

An armoured cable shall connect the junction box to the meter cabinet. This armoured cable may be installed underground in a conduit.

5.3 Outdoor Metering Kits

A metering kit consists of three VTs and three CTs mounted on a common support rack.

Where a pole top outdoor metering kit is installed, for 4 wire 3 element 12 kV class and 25 kV class power line applications, it shall be installed in accordance with the requirements of this section. If the meter cabinet is installed outside station ground grid, bonding and grounding equipment shall be installed per ES43 R3-05.03 in front of cabinet doors.

For any new installations, BC Hydro does not offer metering kits for 3 wire 2 element power line applications.

5.3.1 Meter Cabinet at the Base of the Pole

Where the meter cabinet is located at the base of the pole, an armoured cable shall connect the metering kit secondary winding terminal box directly to the meter cabinet. This armoured cable shall not be installed underground.

5.3.2 Meter Cabinet not at the Base of the Pole

Where the meter cabinet is not located at the base of the pole, an armoured cable shall connect the metering kit secondary winding terminal box to a junction box located at the base of the pole. This armoured cable shall not be installed underground.

A second armoured cable shall connect the junction box to the meter cabinet. The second armoured cable may be installed underground in a conduit.

5.3.3 Typical Installation Drawing

See the separate drawing ES43 J7-01.01 in the “*BC Hydro Distribution Standards Overhead Electrical ES43 series*” document. For complex revenue metering, the following changes are required:

- Change the designation of the “Source” side of the metering kit to “To BC Hydro”; and
- Change the designation of the “Load” side of the metering kit to “To Customer/Power Generator”; and
- Where the meter cabinet is at the base of the pole, replace the meter cabinet (item 2) with the much larger meter cabinet used for complex revenue metering; and
- Where the meter cabinet is not at the base of the pole, replace the meter cabinet (item 2) with a junction box and armoured cable for connection to the larger meter cabinet used for complex revenue metering.

5.4 Individual Indoor VTs and CTs

Where individual indoor VTs and CTs are installed in switchgear, they shall be installed in accordance with the requirements of this section. The switchgear assembly shall comply with CSA Standard C22.2 No. 31-10, and in particular if located outdoor, Section 4.1.6 shall be met.

5.4.1 Instrument Transformer Compartment

The VTs and CTs shall be installed in a switchgear instrument transformer compartment. The instrument transformer compartment shall:

- (a) Be barriered off from other compartments; and
- (b) Not be used as a splitter; and
- (c) Not contain devices and connections other than the BC Hydro revenue metering equipment;
- (d) Not require access through other compartments; and
- (e) Be permanently labelled as “BC Hydro Metering”.

It is acceptable to provide openings, of sufficient size to maintain the required phase bus clearances, through the sides of the instrument transformer compartment, i.e. there is no requirement to completely barrier these openings with insulating material up to and/or contacting the phase buses.

Where it is necessary to route the VT and CT secondary winding wiring through other switchgear compartments, the VT and CT secondary winding wiring shall be installed in a continuous conduit, without access fittings, within the switchgear.

5.4.2 Instrument Transformer Compartment Doors

When (viewed through the open front instrument transformer compartment door) the phase buses are “side-by-side” and all VT and CT primary winding and secondary winding connections are readily accessible, only a front instrument transformer compartment hinged door is required. See drawing TM-A-1144.

However, when (viewed through an open instrument transformer compartment door) the phase buses are “one-behind-the-other”, both a front and a rear instrument transformer compartment hinged door shall be provided. See drawing TM-A-1145.

No means of access, other than through the hinged instrument transformer compartment door(s) shall be provided. Each door shall have provision for locking with an 8 mm (5/16”) shank padlock.

5.4.3 Interlocks

All instrument transformer compartment doors shall be key interlocked.

The provision in CSA Standard C22.2 No. 31-10 Section 8.2.1.7 permitting locking in lieu of an interlock is not acceptable.

Where there is both a front and a rear door, providing a latching mechanism, that can only be released from within the switchgear instrument transformer compartment, in lieu of a second key interlock, is not acceptable. Key interlocks are required on both doors. The interlock scheme shall be designed so that both doors can be opened concurrently.

5.4.3.1 Load Only Applications

For **load only** applications, **where there is not a likely potential for power backfeed**, all instrument transformer compartment doors shall be key interlocked with a BC Hydro (line) side disconnect device. The key interlock(s) shall prevent opening the instrument transformer compartment door(s) unless the disconnect device is visibly open.

For **load only** applications, **where there is a likely potential for power backfeed**, all instrument transformer compartment doors shall be key interlocked with a BC Hydro side (line) disconnect device and a Customer (load) side disconnect device(s). The key interlocks shall prevent opening instrument transformer compartment door(s) unless all disconnect devices are visibly open.

Examples of the potential for power backfeed include:

- *Where, by special permission from BC Hydro, there are multiple POMs on the Customer side of multiple power transformers and the power transformer secondary windings may be paralleled; or*
- *Where the Customer has power generation that may be synchronized with BC Hydro.*

However, where the Customer has generation connected via a CSA approved break-before-make transfer switch, no potential for power backfeed is deemed to exist and only a BC Hydro (line) side disconnect is required.

5.4.3.2 Power Generator Applications

For Power Generator applications, all instrument transformer compartment doors shall be key interlocked with a BC Hydro side disconnect device and a Power Generator side disconnect device(s). The key interlocks shall prevent opening instrument transformer compartment door(s) unless all disconnect devices are visibly open.

5.4.3.3 Commissioning

Prior to energization, the Customer/Power Generator shall:

- Completely install and test the key interlock system; and
- Remove and secure any spare keys; and
- Demonstrate the complete operation of the key interlock system to the BC Hydro field meter technician.

Problems arise more frequently when the Customer/Power Generator obtains the key interlock system from one vendor and is required to mount components on equipment supplied by another vendor. All of this work must be complete and functional.

5.4.4 Neutral Bus

For 4 wire 3 element revenue metering applications, the neutral bus, or a neutral bus tap extension, shall be extended to the instrument transformer compartment. It shall be rigid bus not less than 25 mm x 6 mm (1" x 1/4"). Except where it connects to the ground bus, it shall be supported on insulators.

5.4.5 Ground Bus

The switchgear ground bus shall:

- (a) Be extended to the instrument transformer compartment; and
- (b) Have provision for terminating the BC Hydro installed meter cabinet conduit bonding conductor with either:
 - A 10-32 screw and washer; or
 - A mechanical connector suitable for a #12 to #8 AWG conductor.

5.4.6 Working Ground Points

In compliance with the WorkSafeBC Occupational Health and Safety Regulations, working ground points, complete with a permanently mounted 25 mm (1") diameter ball type ground stud Hubbell Chance C600-2102 (or equivalent), shall be provided at the following locations within the instrument transformer compartment:

(a) For 3 wire 2 element revenue metering applications:

- On each side of the phase A CT; and
- On each side of the phase C CT; and
- On phase B; and
- On the ground bus,
i.e. a total of 6 ground studs.

(b) For 4 wire 3 element revenue metering applications:

- On each side of the phase A CT; and
- On each side of the phase B CT; and
- On each side of the phase C CT; and

- On the ground bus,
i.e. a total of 7 ground studs.

Each ground stud shall be positioned for unobstructed application of a ground clamp using a hot stick. Where there are two doors, all working ground points shall be accessible from the same door.

The ground bus ground stud shall be located immediately behind the instrument transformer compartment door.

Where there is both a front and a rear instrument compartment door, a single ground bus ground stud shall be located immediately behind the same door as the other ground studs.

5.4.7 VTs and CTs

5.4.7.1 Installation

The VTs and CTs should preferably be installed, and the primary winding connections made, at the switchgear manufacturer's factory. Alternatively, this work may be done by the Customer/Power Generator in the field. Regardless of where the work is done, the Customer/Power Generator shall be solely responsible for insuring that the installation is in accordance with the switchgear manufacturer's and the local inspection authority's requirements.

5.4.7.2 Electrical Clearances

Minimum electrical clearances shall be in accordance with the published switchgear manufacturer's requirements.

While the following clearances are typical:

- 150 mm (6") for 12 kV class Phase-to-Phase; and
- 125 mm (5") for 12 kV class Phase-to-Ground; and
- 230 mm (9") for 25 kV class Phase-to-Phase and Phase-to-Ground;

it is essential that the specific switchgear manufacturer's requirements be maintained since the switchgear certification and electrical performance is based on maintaining the published clearances.

In addition, physical clearances between the VT or CT body and adjacent VT or CT bodies and ground shall be maintained. Contact BC Hydro for specific VT/CT body clearance requirements.

5.4.7.3 Accessibility

The VT and CT primary winding terminals and secondary winding terminals shall remain accessible for termination and the nameplates shall remain visible. The installation shall facilitate the easy replacement of the VTs, VT fuses and CTs.

When the phase buses are “one-behind-the-other”, the VT secondary winding terminals typically face the side of the instrument transformer compartment. 300 mm (12”) clearance should be maintained between the side of the instrument transformer compartment and the VT secondary winding terminals.

5.4.7.4 VT Installation and Connections

The VT primary winding fuses shall be in the horizontal position.

| The VT shall be installed a minimum of 150 mm (6”) above the bottom of the enclosure.

The VT H1 primary winding conductors: (and for 3 wire 2 element applications, the H2 primary winding conductors):

- (a) Shall be sized and supported in accordance with the switchgear manufacturer’s requirements with regard to clearances, fault current bracing, partial discharge etc.; and
- (b) Shall be permanently connected. *Drawout or automatic self-disconnecting VT primary winding connections are not acceptable.* and;
- (c) For 12 kV class and lower voltages, shall be not less than a #6 AWG conductor; and
- (d) For 25 kV class voltages, shall be a 1” x ¼” rigid bus. See drawing TM-A-1146. *The fuse holder(s) for 25 kV class VTs is typically cantilevered from the primary winding VT terminal(s). The 1” x ¼” rigid bus is required to provide support and stability to the fuse holder and to prevent its rotation.*

For 4 wire 3 element applications, each VT H2 primary winding terminal shall be connected to the neutral bus with a separate minimum #8 AWG white insulation conductor, *i.e. daisy chaining is not acceptable.*

| For switchgear applications only, and as an exception to the industry convention, the Phase C to Phase B VT primary winding polarity is reversed to simplify the connections. *To correct the VT primary winding polarity reversal, BC Hydro also reverses the secondary winding polarity.*

5.4.7.5 CT Installation and Connections

The CT H1 primary polarity marks shall be towards BC Hydro. Except that, if this orientation prevents access to the secondary winding terminals, the primary winding polarity marks may be towards the Customer/Power Generator. BC Hydro shall be advised if this exception occurs. *In this instance, to correct the CT primary winding polarity reversal, BC Hydro also reverses the secondary winding polarity.*

5.4.7.6 Mounting and Grounding

The VTs and CTs shall be bolted to grounded metal panels using all of the supplied mounting holes. Paint or other protective coatings shall be removed to ensure a low impedance ground connection. Lockwashers shall be installed.

If the VTs or CTs **have** an external ground connector, it shall be connected to the ground bus with a minimum #8 AWG bare or green insulation conductor.

*If the VTs or CTs **do not have** an external ground connector, the mounting bolts and lockwashers are considered to provide adequate bonding.*

6. Meter Cabinet

6.1 Location

The meter cabinet shall be installed in an outdoor or indoor location acceptable to BC Hydro.

Indoor locations are preferred. For outdoor locations, the meter cabinet is supplied complete with thermal insulation and a heater.

Secondary cables' length from meter cabinet to instrument transformers should be less than 50 m (170').

6.2 Installation

The, BC Hydro stock number 372-9210 drawing G-D08-A160 Page 1, meter cabinet shall be wall or post mounted. The top of the meter cabinet shall be 1,500 mm (5') to 1,800 mm (6') above finished grade. The VT and CT secondary winding armoured cable or conduit shall enter the meter cabinet through the bottom approximately 405 mm (16") from the left only.

Drawing G-D08-A160 Page 3 indicates a typical outdoor post mounted meter cabinet installation.

Drawing TM-A-1169 indicates the meter cabinet conduit termination for outdoor installations.

6.3 Grounding

In accordance with Section 36 of the *Canadian Electrical Code*, an external meter cabinet ground conductor, not less than #2/0 AWG copper, shall be installed to bond the meter cabinet to the station ground grid electrode.

A #2/0 AWG copper conductor is required since, due to skin effect, its large surface area provides a low impedance path for high frequency electrical noise.

6.4 Auxiliary Power

A dedicated high reliability 120 V AC 15 A circuit shall be provided to the meter cabinet.

Where there is a critical power bus, supplied via a transfer switch from an emergency generator or multiple supply lines, the meter cabinet shall be supplied from the critical power bus. *However, a battery powered UPS supply is not required.*

7. VT and CT Secondary Winding Wiring

7.1 General

No other devices shall be connected to the VT and CT secondary windings used by the BC Hydro revenue metering equipment.

As per the Responsibilities and Charges section of this document, BC Hydro is responsible for all VT and CT secondary winding conductor terminations. BC Hydro will wire directly to the VT and CT secondary winding terminals with the Measurement Canada approved multi-colour insulation conductors.

69 kV class and greater VTs and CTs supplied by BC Hydro have a second set of secondary windings which will be terminated at a second JB.

7.2 Access to the Second set of Secondary Windings

Customer access to the second set of secondary windings may be provided subject to the “Agreement for Access to BC Hydro Metering Transformer Secondary Windings”. Where the Customer elects to use the second set of VT and CT secondary windings:

(a) Use of these windings shall be restricted to the connection of:

- Check meters;
- Demand or energy management devices;
- Voltmeter, ammeter or other similar instruments; or
- Under-frequency relays.

These windings do not have a protective relaying rating. Therefore, other than for under-frequency applications, they shall not be used for protective relaying.

(b) The connected load shall not exceed the VT or CT secondary winding maximum nameplate burden; and

(c) The VT and CT secondary winding circuits shall be grounded at single locations only. Failure to comply with this requirement may result in equipment damage and/or personnel injury; and

(d) The VT secondary winding circuit shall not be short circuited. Failure to comply with this requirement may result in equipment damage and/or personnel injury; and

(e) The CT secondary winding circuit shall not be open circuited. Failure to comply with this requirement may result in equipment damage and/or personnel injury; and

- (f) The second set of secondary winding will be terminated in a separate JB at the CT/VT structure. This JB will be installed side-by-side or back-to-back with the BC Hydro revenue metering JB. BC Hydro will provide secondary cables from the customer JB to a test block as the demarcation point between the BC Hydro and the Customer/Power Generator wiring. The Customer/Power Generator shall not alter the wiring on the BC Hydro side of the test block. The Customer/Power Generator shall be solely responsible for the wiring and the equipment on their side of the test block.

7.3 Cables

7.3.1 Typical Configurations

Typical cable configurations are:

From	To	Typical Cable
Individual Outdoor VTs and CTs	Junction Box or Meter Cabinet	Armoured cable strapped to VT/CT support structure *
Outdoor Metering Kit	Junction Box or Meter Cabinet	Armoured cable strapped to pole
Junction Box	Meter Cabinet	Armoured cable in underground PVC conduit or above ground cable tray
Individual Indoor VTs and CTs located in the Switchgear Instrument Transformer Compartment	Meter Cabinet	Individual conductors in conduit

* For 69 kV class and greater applications, where the Customer/Power Generator has requested access to the second set of secondary windings, there are 2 armoured cables per VT/CT.

7.3.2 Armoured Cable Requirements

Armoured cable(s) between individual outdoor VTs and CTs or an outdoor metering kit and the junction box or meter cabinet shall not be installed underground.

Armoured cable from the junction box to the meter cabinet may be installed underground. Underground armoured cable shall be installed in a 3" rigid PVC conduit. It shall not be installed in rigid metal conduit or be directly buried.

The VT secondary winding circuits in the armoured cable from the individual outdoor VTs and CTs do not have overcurrent protection. To reduce the chance of a fault, these armoured cables may not be installed underground. A possible exception is made where individual outdoor VTs and CTs are installed on separate outdoor pedestals and it is impractical to provide cable support between them and the junction box or meter cabinet.

When a junction box is used, it contains a circuit breaker to protect the VT secondary winding circuits in the armoured cable between the junction box and the meter cabinet.

Water in conduits can cause crushing and expansion of conductor insulation due to repeated freezing and thawing cycles. It has been BC Hydro's experience that, since it does not expand as much as PVC conduit, rigid metal conduit installations may result in conductor insulation damage.

7.3.3 Individual Conductors in Conduit Requirements

Where applicable, a conduit shall be installed between the switchgear instrument transformer compartment and the meter cabinet.

The conduit shall be either rigid metal, EMT or rigid PVC. The conduit shall have not more than the equivalent of three 90° bends and shall not exceed 25 m in length. The conduit minimum trade size shall be:

- 1 ¼" (35) trade size for lengths up to 10 m; or
- 1 ½" (41) trade size for lengths from 10 m to 25 m.

The conduit shall be continuous and without access fittings. Except that, a "LB style" fitting may be installed immediately adjacent to the meter cabinet provided the cover remains clearly visible and has provision for the installation of a cover seal.

The conduit shall remain visible for its entire length except where it is embedded in concrete or, subject to approval by BC Hydro, where it passes through a wall. The conduit shall not be installed underground outdoors.

Where it is necessary to route the VT and CT secondary winding wiring through other switchgear compartments, the VT and CT secondary winding wiring shall be installed in a continuous conduit, without access fittings, within the switchgear.

A pull string shall be left in the conduit.

8. Telecommunications

A telecommunication means is required for remote reading of the main meter and backup meter. Conventional wire-line or alternative wire and wireless technologies may be used, e.g. cellular, fiber optic, radio, satellite etc. The Revenue Metering department should be contacted for approval before committing to one alternative. The telecommunication solution shall be coordinated between BC Hydro, the Customer/Power Generator and the telecommunication company.

As indicated in the following section, because of the complications associated with transmission system connected facilities using conventional wire-lines telephone lines, alternative wireless technologies are preferred.

A telephone switcher is typically used to select either the main meter or the backup meter. It is preferred that only the main meter and the backup meter be connected to the telephone switcher. However, for Generation applications, the Power Parameter Information System (PPIS) meter may also be connected to the telephone switcher.

8.1 Transmission System Connected Facilities with Wire-Line Telephone

Where the POI is to the 69 kV class or higher BC Hydro transmission system **and** where a conventional wire-line telephone is installed, ground potential rise (GPR) protection shall be provided.

When a power system ground fault occurs, all or some of the fault current returns via the earth through the ground grid and produces a potential difference between the ground grid and remote earth. This potential difference is defined as power station ground potential rise (GPR). Where a wire-line circuit is used, GPR protection designed, installed and maintained in accordance with "IEEE Standard 487 Guide for the Protection of Wire-Line Communication Facilities Serving Electric Power Stations" is required. Failure to follow this standard may result in equipment damage and/or personnel injury.

Wire-line GPR protection typically includes an optical isolator, manufactured by Positron Industries Inc. or equivalent, located in a non-metallic telephone GPR isolation cabinet.

The telephone GPR isolation cabinet shall be connected, via a high voltage telephone cable used for no other purpose, to the telephone companies general feeder cable at a point beyond the power station GPR zone of influence. To provide additional protection within the power station, the high voltage telephone cable shall be installed within a continuous PVC conduit. The PVC conduit shall extend to a point not less than 3 m beyond the substation fence and ground grid. Once the high voltage telephone cable leaves the conduit, it may be direct buried. The direct buried cable shall not be installed within 300 mm (12") of any metallic object. The high voltage telephone cable shall not be spliced.

In addition to the revenue metering wire-line circuit, there may be numerous other voice, data, instrumentation and control circuits which may also require GPR protection by the Customer/Power Generator.

8.2 Distribution System Connected Facilities with Wire-Line Telephone

| Where the POI is to the 25 kV class or lower BC Hydro distribution system, a high speed telephone line electronic protector is required. It shall be mounted external to the meter cabinet and shall be bonded to ground with a minimum #6 AWG ground wire.

The high speed electronic protector is in addition to the telephone company's protector. It should be located on the Customer/Power Generator side of the telephone companies protector. It is for use with one balanced pair and is complete with an enclosure. Further information is available at WWW.CIRCATEL.COM (Products / Station Protectors / Station Protector Enclosures / 1-2 Pair).

9. Measurement Canada

This section is applicable to Power Generators only.

As the seller of electricity, the Power Generator, is required by Measurement Canada to hold a Certificate of Registration and to be in compliance with the “*Electricity and Gas Inspection Act and Regulations*”. Power Generators shall submit a copy of their Certificate of Registration and/or the approval number to BC Hydro.

Power Generators may find additional information and forms at the Measurement Canada website under Contractor Registration:

http://www.ic.gc.ca/eic/site/mc-mc.nsf/eng/h_lm00008.html

These requirements apply for all generation applications even though BC Hydro supplies the meter(s).

The “Electricity and Gas Inspection Act and Regulations” uses the term “Contractor” to refer to the Power Generator.

10. Responsibilities and Charges

The revenue metering responsibilities and charges shall be in accordance with the specific Customer or Power Generator contractual documents. *However, the following sections indicate the typical Customer or Power Generator responsibilities and charges.*

10.1 Responsibilities

The following table defines specific responsibilities.

- BCH BC Hydro
- Cust Customer
- PG Power Generator

Item		For Load Only Applications By	For Generation Applications By
For Individual Outdoor VT and CT (includes combined VT/CT units) Applications Only			
VTs and CTs	Material	BCH	PG
	Support Structure	Cust	PG
	Installation	Cust	PG
	Primary Winding Conductor Terminations	Cust	PG
	Secondary Winding Conductor Terminations	BCH	BCH
Junction Boxes (Where applicable)	Material	BCH	BCH
	Installation	Cust	PG
	Conductor Terminations	BCH	BCH
Cable and Connectors between: VTs and Junction Box CTs and Junction Box Junction Box and Meter Cabinet	Material	BCH	BCH
	Installation	Cust	PG
	Conductor Terminations	BCH	BCH

Item		For Load Only Applications By	For Generation Applications By
For Outdoor Metering Kit Applications Only			
Metering Kit complete with VTs and CTs	Material	BCH	BCH
	Pole	Cust	PG
	Installation	Cust	PG
	Lightning Arrestors Material	BCH	BCH
	Lightning Arrestors Installation	Cust	PG
	Primary Winding Conductor Terminations	Cust	PG
	Secondary Winding Conductor Terminations	BCH	BCH
Metering cabinet bonding and grounding equipment	Material	BCH	BCH
	Installation	Cust	PG
Junction Box at Base of Pole (where applicable)	Material	BCH	BCH
	Installation	Cust	PG
	Conductor Terminations	BCH	BCH
Cable and Connectors between the Metering Kit, Junction Box (where applicable) and Meter Cabinet	Material	BCH	BCH
	Installation	Cust	PG
	Conductor Terminations	BCH	BCH
For Individual Indoor VT and CT Applications Only			
VTs and CTs	Material	BCH	PG
	Switchgear Instrument Transformer Compartment	Cust	PG
	Installation	Cust	PG
	Primary Winding Conductor Terminations	Cust	PG
	Secondary Winding Conductor Terminations	BCH	BCH
Cable Between VTs, CTs and Meter Cabinet	Conduit Material and Installation	Cust	PG
	Cable Material	BCH	BCH
	Cable Installation	BCH	BCH
	Conductor Terminations	BCH	BCH

Item		For Load Only Applications By	For Generation Applications By
For All Applications			
Measurement Canada Certificate of Registration	Documentation	BCH	PG
Measurement Canada Approval Number for VTs/CTs	Documentation	BCH	PG
Main Meter	Material & Installation	BCH	BCH
Backup Meter	Material & Installation	BCH	BCH
Meter Cabinet	Material	BCH	BCH
	Installation	Cust	PG
	Connections	BCH	BCH
Meter Cabinet Ground	Material & Installation	Cust	PG
Meter Cabinet 120 V AC Auxiliary Power	Material & Installation	Cust	PG
Telecommunications – Conventional Wire-Line	Material & Installation	Cust	PG
Telecommunications – Cellular, Fiber Optic, Radio or Satellite	Material & Installation	Application Specific – To Be Determined	Application Specific – To Be Determined
Telephone Switcher	Material & Installation	BCH	BCH
Ground Potential Rise (GPR) Protection (Applicable to Transmission System Connected Facilities using Wire-Line Telephone Lines)	Design, Material & Installation	Cust (See Note 1)	PG (See Note 1)
High Speed Telephone Line Electronic Protector (Applicable to Distribution System Connected Facilities using Wire-Line Telephone Lines)	Material, Installation & Maintenance	BCH	PG

Note 1

For transmission system connected applications, where a conventional wireline telephone circuit is used:

- The Customer/Power Generator shall provide written confirmation, signed by a professional engineer, that "Ground potential rise (GPR) protection has been designed and installed in accordance with IEEE Standard 487 *Guide for the Protection of Wire-Line Communication Facilities Serving Electric Power Stations* and the GPR equipment manufacturers requirements".
- The Customer/Power Generator shall provide written confirmation that they will maintain the GPR protection in accordance with the GPR equipment manufacturers requirements.

10.2 Charges**10.2.1 Customer Charges for Load Only Applications**

For a single POM as determined by BC Hydro, the Customer is typically not charged for the revenue metering material and labour provided by BC Hydro.

If the Customer requests multiple POMs, the Customer is typically charged for the incremental cost associated with the additional POM.

10.2.2 Power Generator Charges for Generation Applications

The Power Generator shall lease the main meter from BC Hydro. Under the terms of the lease, BC Hydro is responsible for the supply, programming, testing, verifying, sealing, maintaining, re-verifying, repairing and/or replacing the main revenue meter in accordance with the "Electricity and Gas Inspection Act and Regulations" as administered by Measurement Canada.

The Power Generator is not charged for the backup meter.

The Power Generator is typically charged for all other revenue metering material and labour provided by BC Hydro.

10.3 Typical Additional Charges for Load Only Customers:

BC Hydro is responsible for the costs incurred to install one point of metering (POM) for Transmission and Distribution Load-Only Customers.

10.3.1 Additional Points of Metering

Customers are fully responsible for the costs incurred to install and operate additional points of metering including material, installation, telecommunication costs and reading fees for the additional point-of-metering. This applies when customer requests a second feeder connection and a second metering point.

Normally a customer can arrange for a single metering point that can be fed from both main and standby circuit, except due to BCH system constraints.

10.3.2 Customer on site Access to real time Revenue Meter Data

10.3.2.1 Distribution Voltage Connected Load Only Customers

If required, the customer could contact BC Hydro Power Smart program administrators to access real time meter data pulses. The cost for this service is a one-time only charge.

10.3.2.2 Transmission Voltage Connected Load Only Customers

If the customer is seeking access to real time meter data, they may use the second set of secondary windings from BC Hydro CTs and VTs (see Section 7.2).

11. Drawings

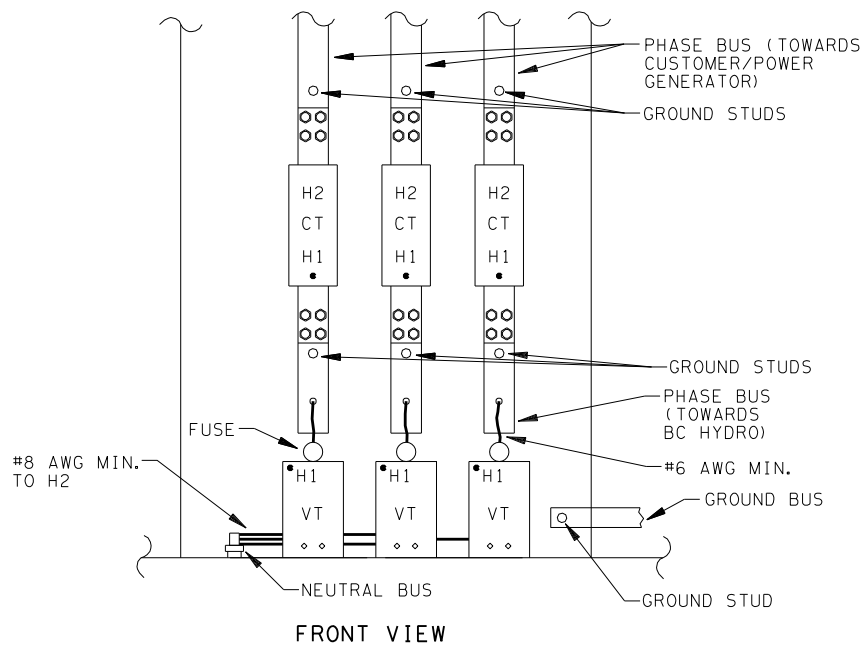
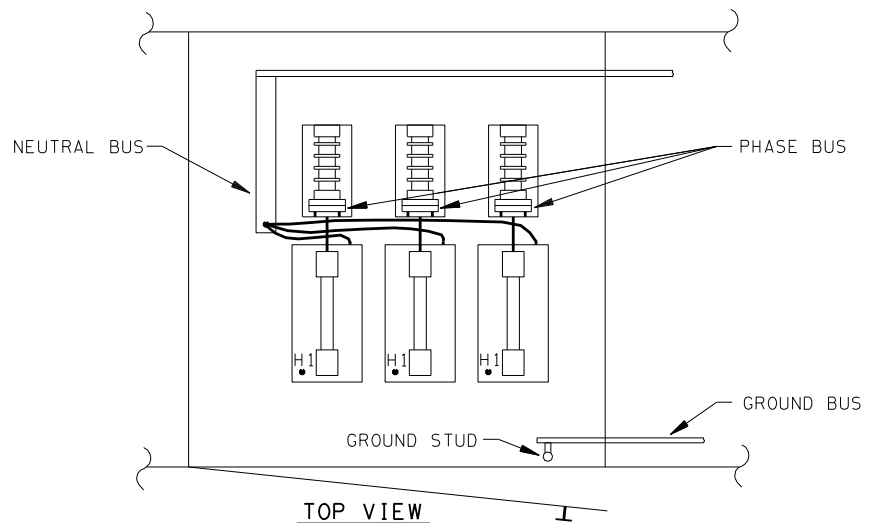
Individual Indoor VTs and CTs

TM-A-1144	Switchgear Instrument Transformer Compartment “Side-by-Side” Phase Buses
TM-A-1145	Switchgear Instrument Transformer Compartment “One-Behind-the-Other” Phase Buses
TM-A-1146	Switchgear Instrument Transformer Compartment 25 kV Class VT Primary Winding Connections

Meter Cabinet

G-D08-A160 Page 1	Remotely Read Load Profile Indoor or Outdoor Meter Cabinet
G-D08-A160 Page 3	Remotely Read Load Profile Indoor or Outdoor Meter Cabinet – Outdoor Post Mounting
TM-A-1169	Rigid PVC Expansion Fitting as A Cover for Conduit and Metering Cable

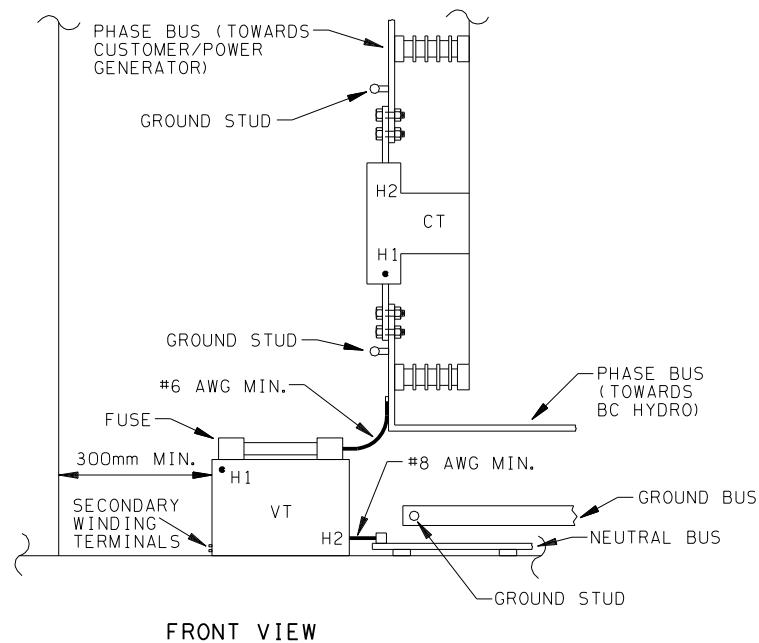
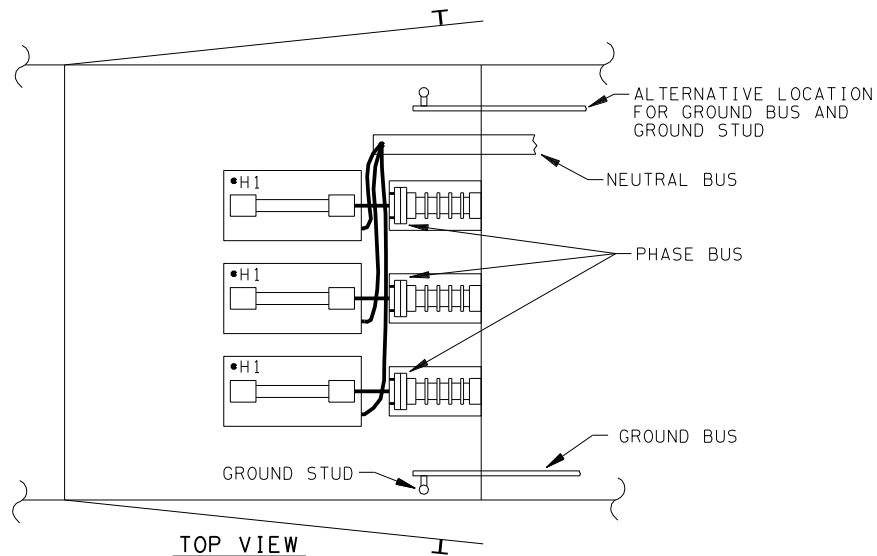
TM-A-1144

**NOTES:**

1. 12 kV CLASS 4 WIRE 3 ELEMENT ILLUSTRATED.
2. ONLY A FRONT DOOR IS REQUIRED.

REVISED	DRAFTER JW	DESIGNER W. CROSS	APPROVED B. HUGHES	SWITCHGEAR INSTRUMENT TRANSFORMER COMPARTMENT "SIDE-BY-SIDE" PHASE BUSES			
	ORIGINAL ISSUE DATE: APRIL 2004						
	BChydro  REVENUE METERING			PAGE OF 1 1	TM-A-1144		R. 0

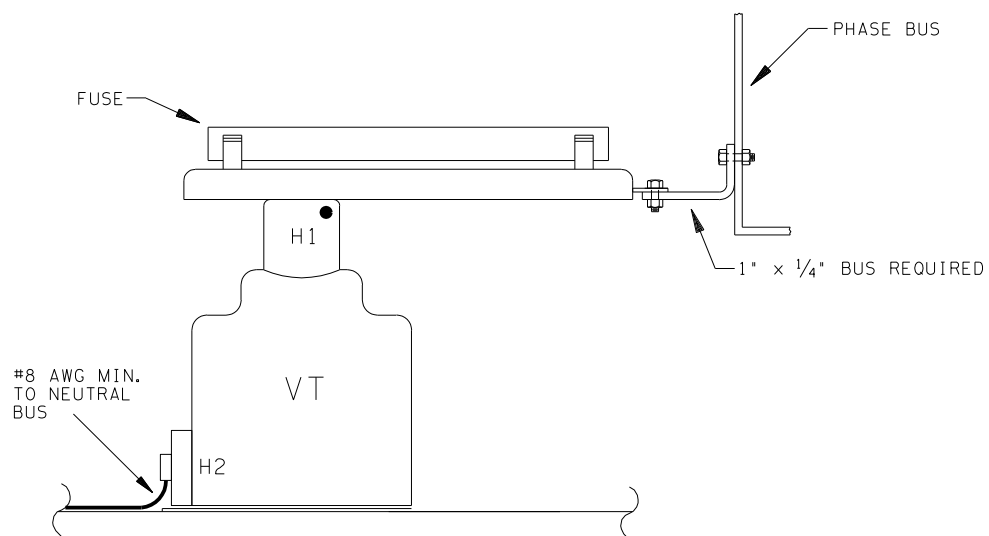
TM-A-1145

**NOTES:**

1. 12 kV CLASS 4 WIRE 3 ELEMENT ILLUSTRATED.
2. BOTH A FRONT AND A REAR DOOR ARE REQUIRED.

REVISED	DRAFTER JW	DESIGNER W. CROSS	APPROVED B. HUGHES	SWITCHGEAR INSTRUMENT TRANSFORMER COMPARTMENT "ONE-BEHIND-THE-OTHER" PHASE BUSES			
	ORIGINAL ISSUE DATE: MARCH 2004						
	BChydro  REVENUE METERING			PAGE OF	1 1	TM-A-1145	R. 0

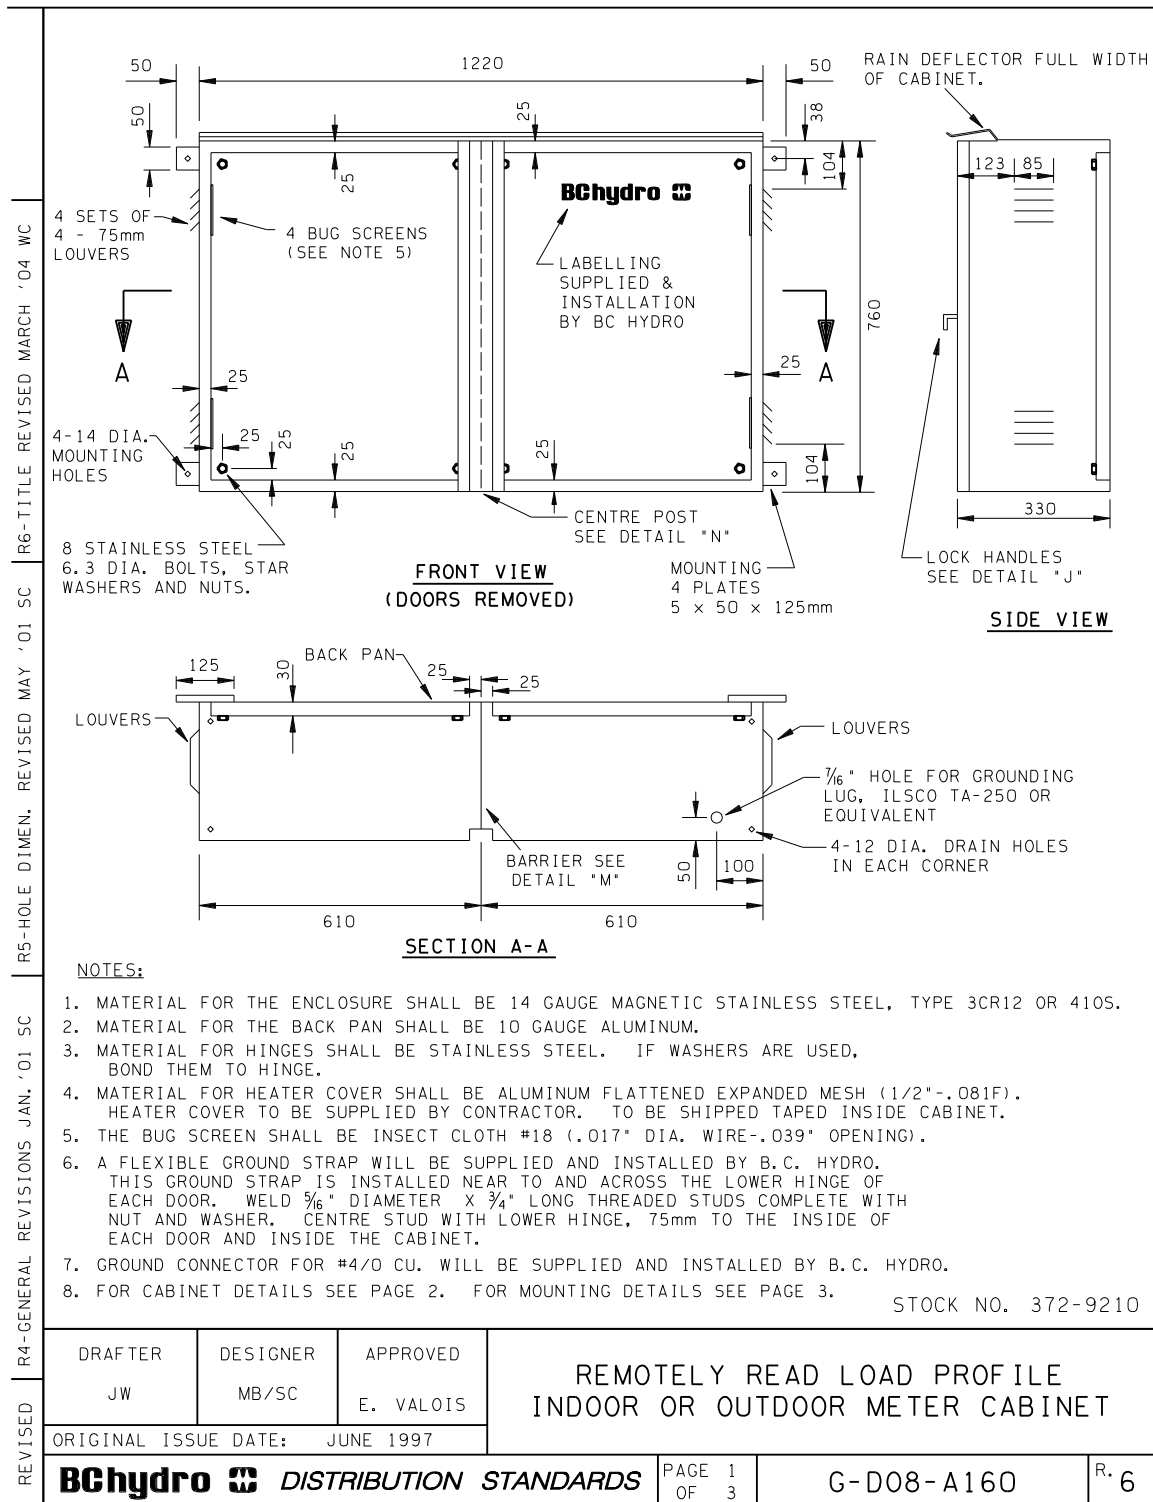
TM-A-1146

**NOTE:**

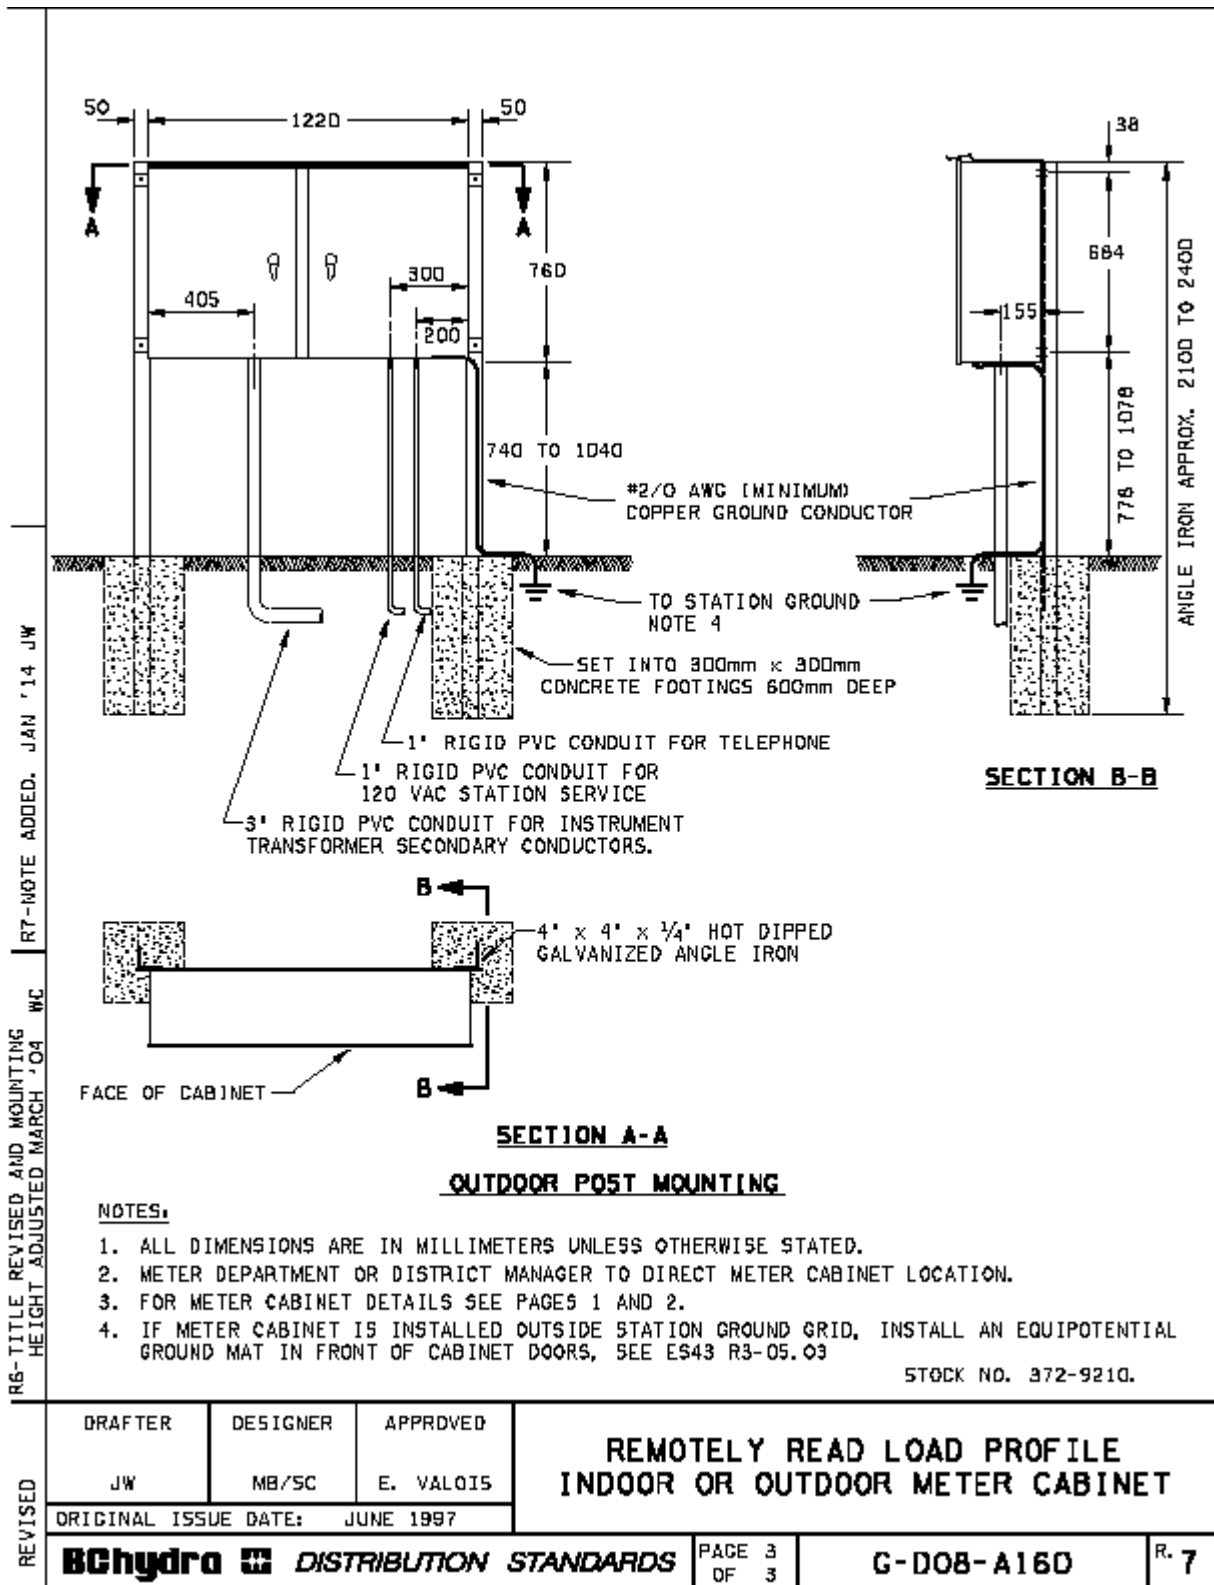
1. THE 1 X 1/4" BUS IS REQUIRED TO PROVIDE SUPPORT AND STABILITY TO THE FUSE HOLDER AND TO PREVENT ITS ROTATION.

REVISED	DRAFTER JW	DESIGNER W. CROSS	APPROVED B. HUGHES	INDOOR 25 kV VT PRIMARY WINDING CONNECTION			
	ORIGINAL ISSUE DATE: APRIL 2004						
	BC Hydro 		REVENUE METERING		PAGE OF	1 1	TM-A-1146

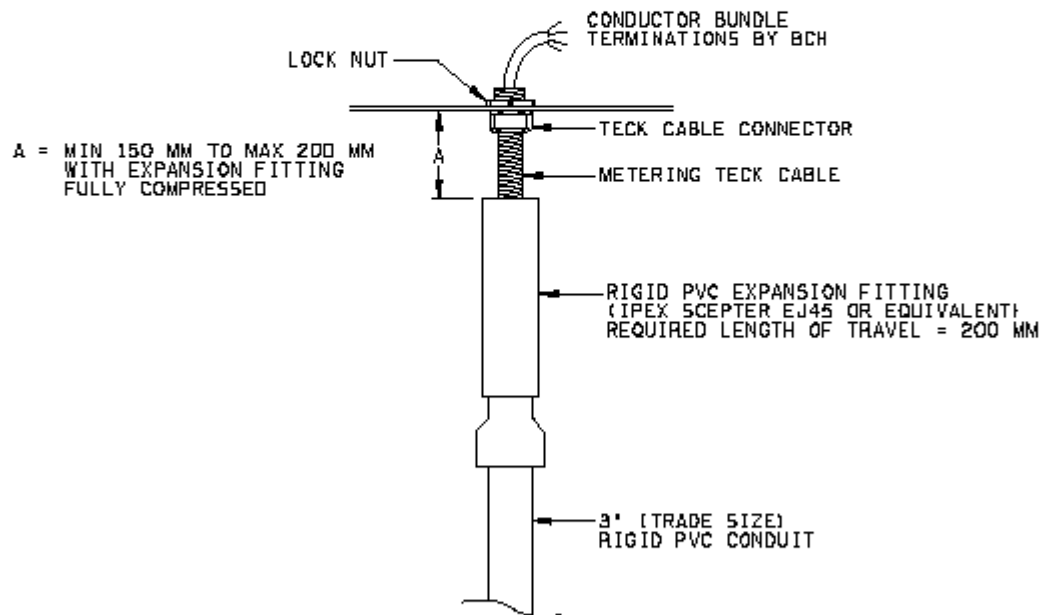
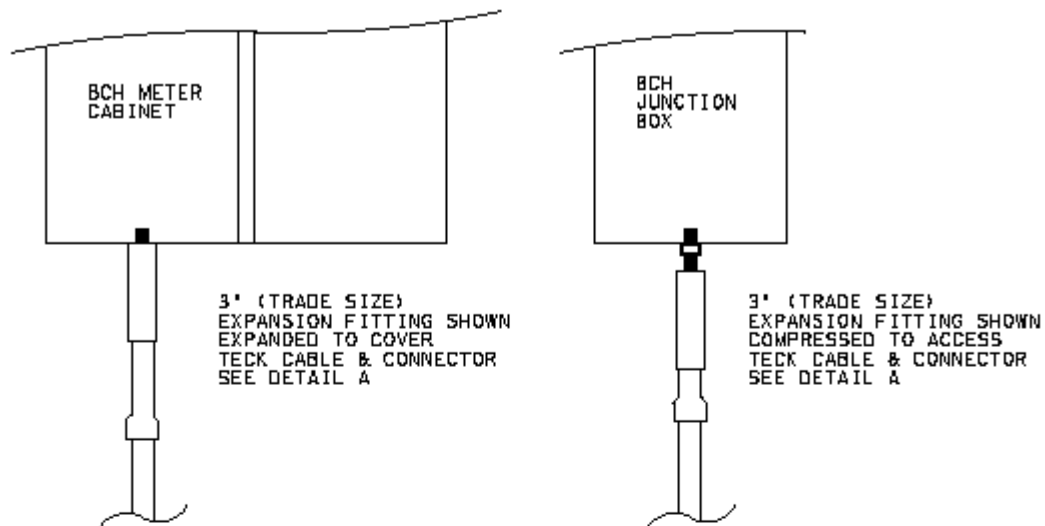
G-D08-A160 Page 1



G-D08-A160 Page 3



TM-A-1169

**DETAIL A**

**Metering Teck Cable installation at Junction Box and
Outdoor Meter Cabinet**

REVISED

DRAFTER	DESIGNER	APPROVED
DC	J. WALTER	J. WALTER
ORIGINAL ISSUE DATE: OCTOBER 2013		

**RIGID PVC EXPANSION FITTING
AS A COVER FOR
CONDUIT AND METERING CABLE**

BC Hydro**REVENUE METERING**PAGE 1
OF 1**TM-A-1169**

R. 0